


SEGMENT G-H, I-J, M-N



NOT TO SCALE

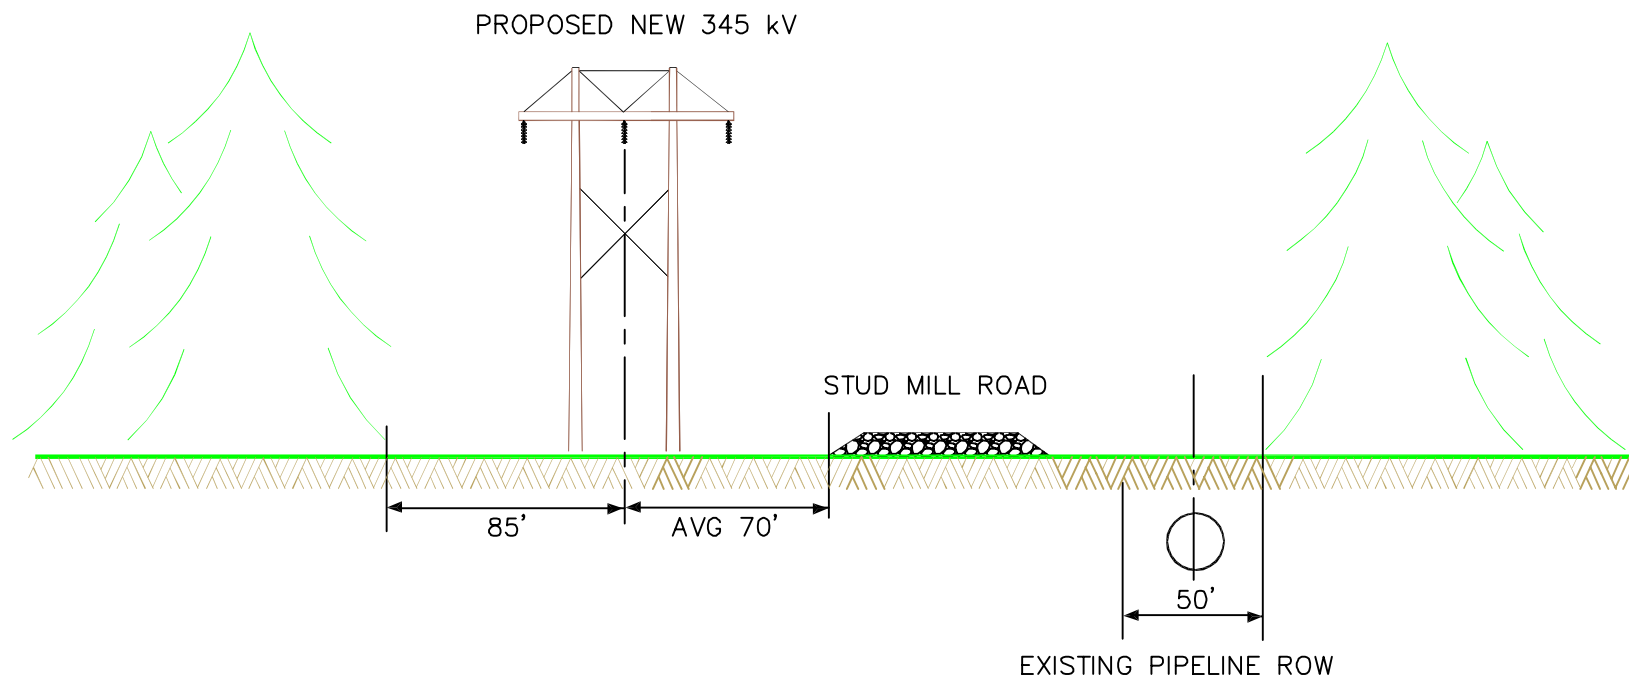

APPENDIX 1-3
TYPICAL ROW CONFIGURATION
ALONG STUD MILL ROAD
AND EXISTING PIPELINE ROW
(OPPOSITE SIDES OF ROAD)
BANGOR HYDRO-ELECTRIC COMPANY
NORTHEAST RELIABILITY INTERCONNECT